



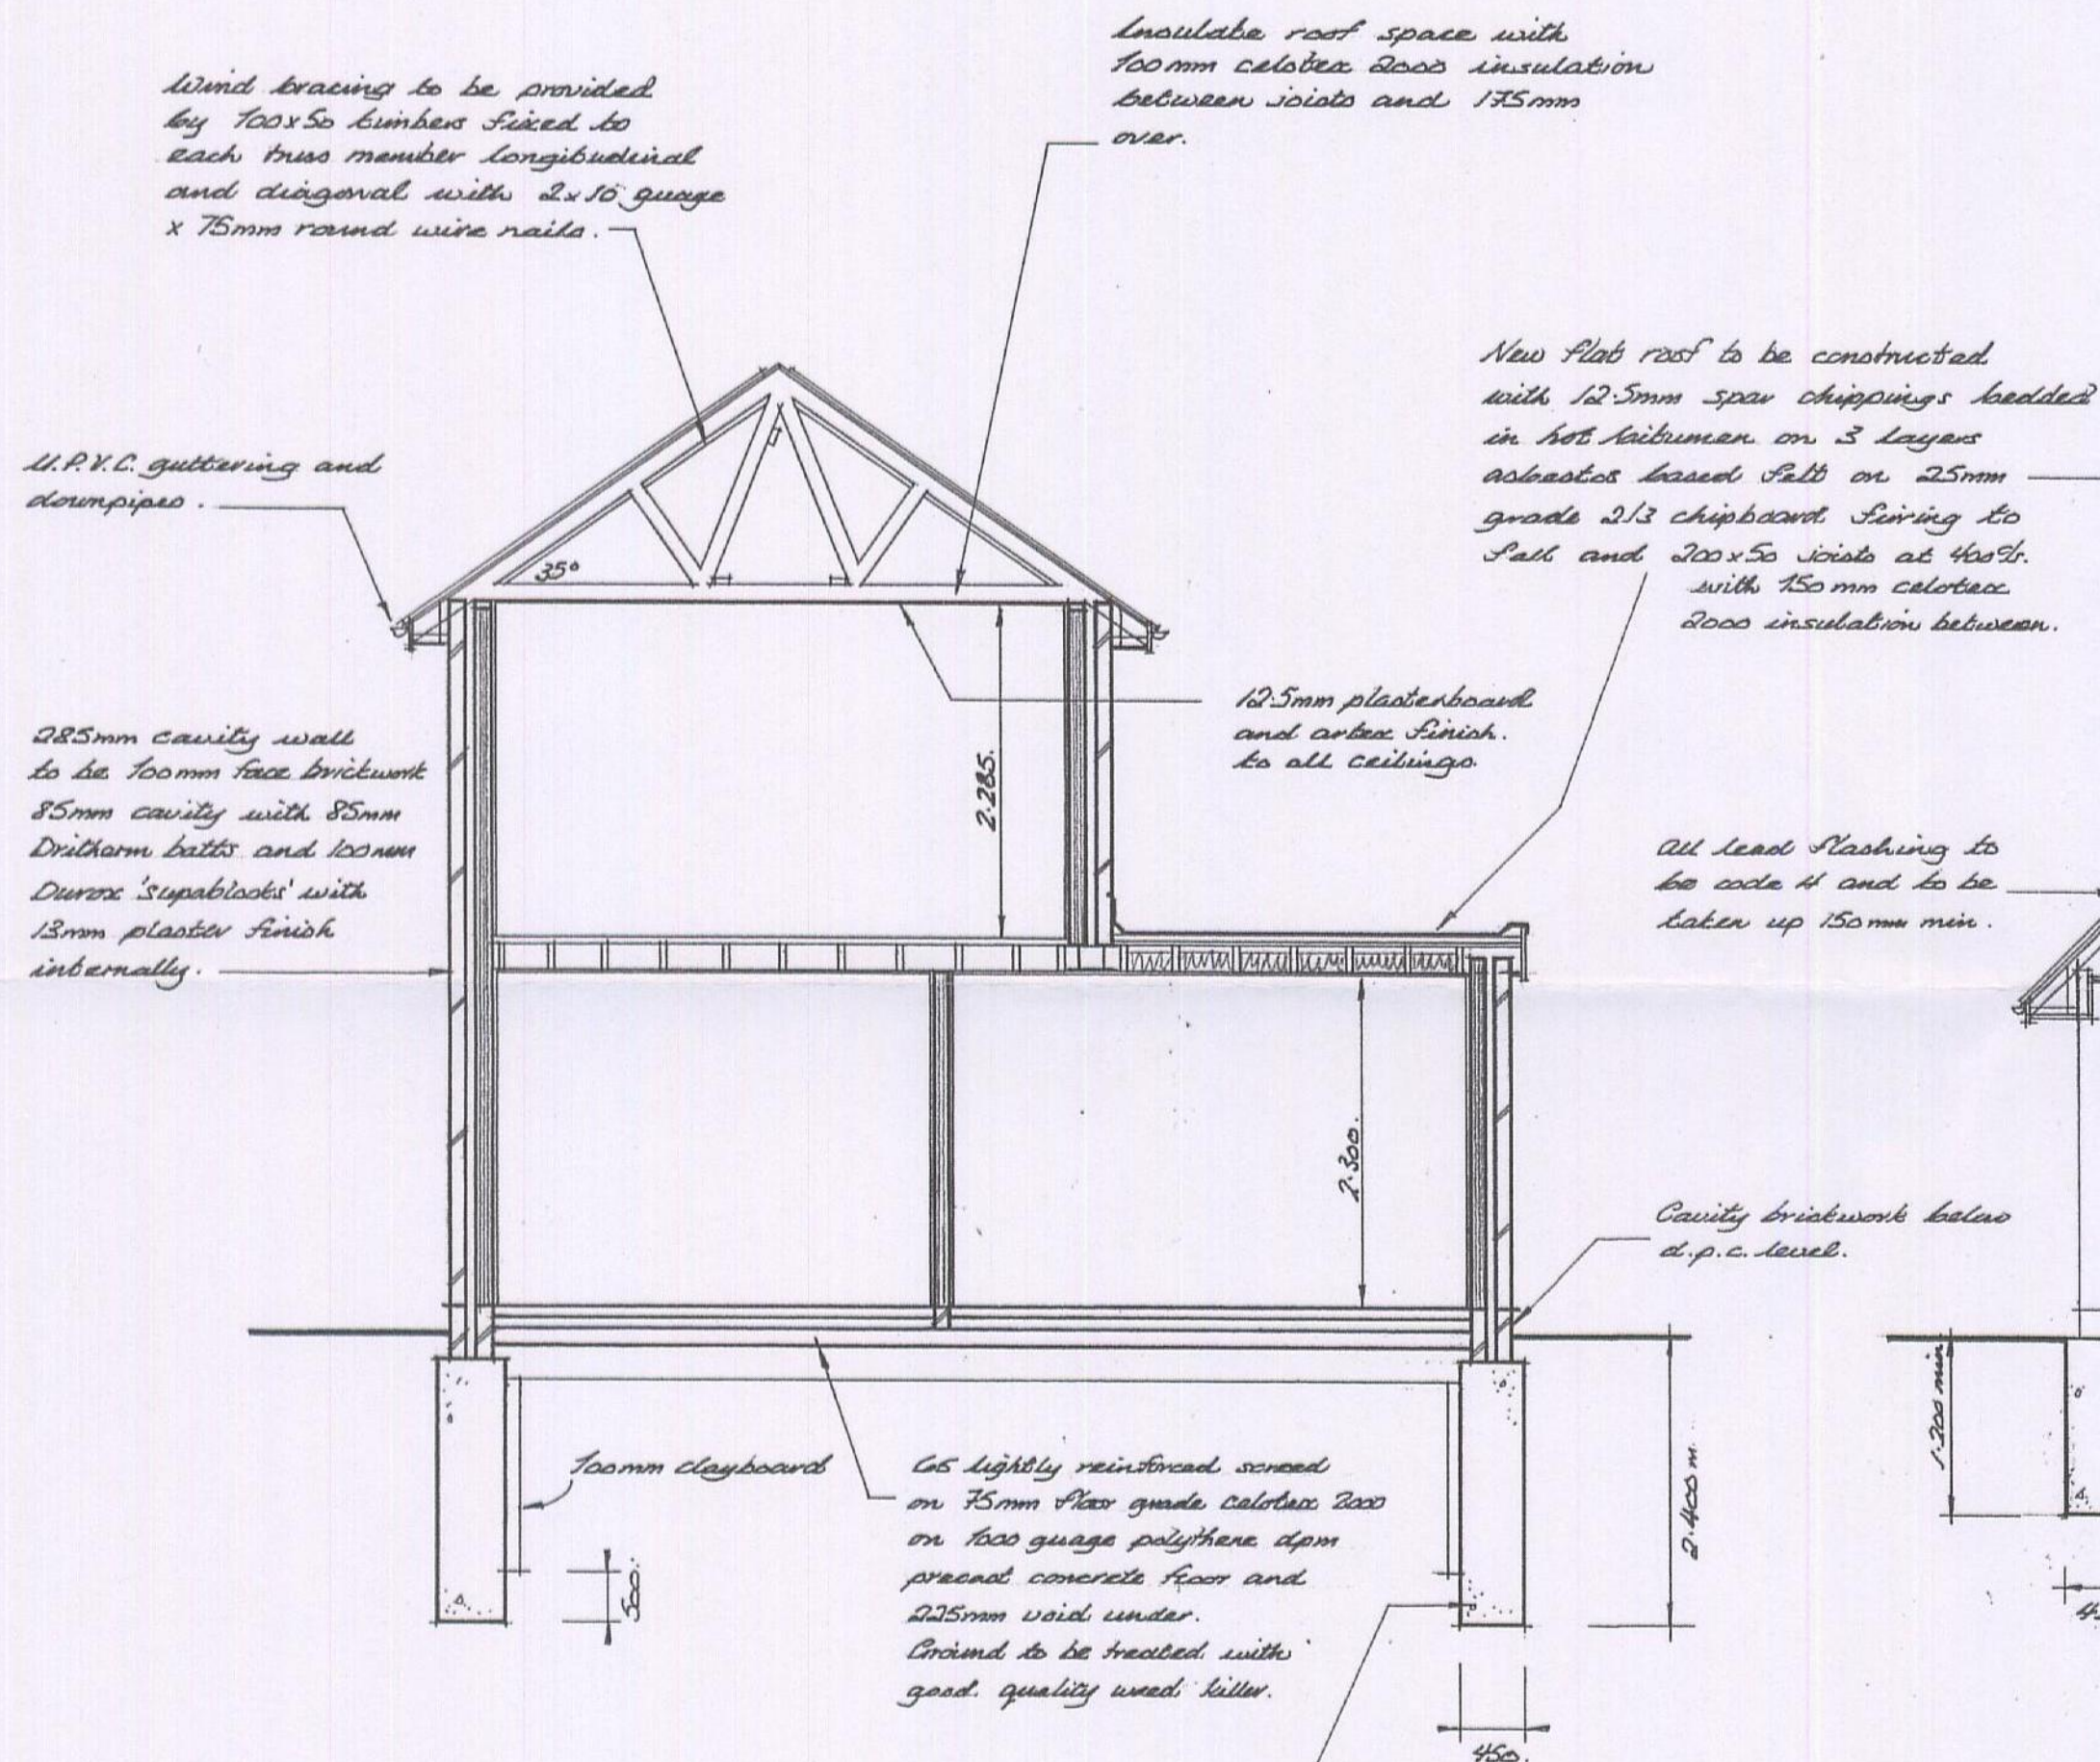

SECTION A-A.

All new foundations to be taken down 600mm below any roof growth and final depth and design subject to site conditions.

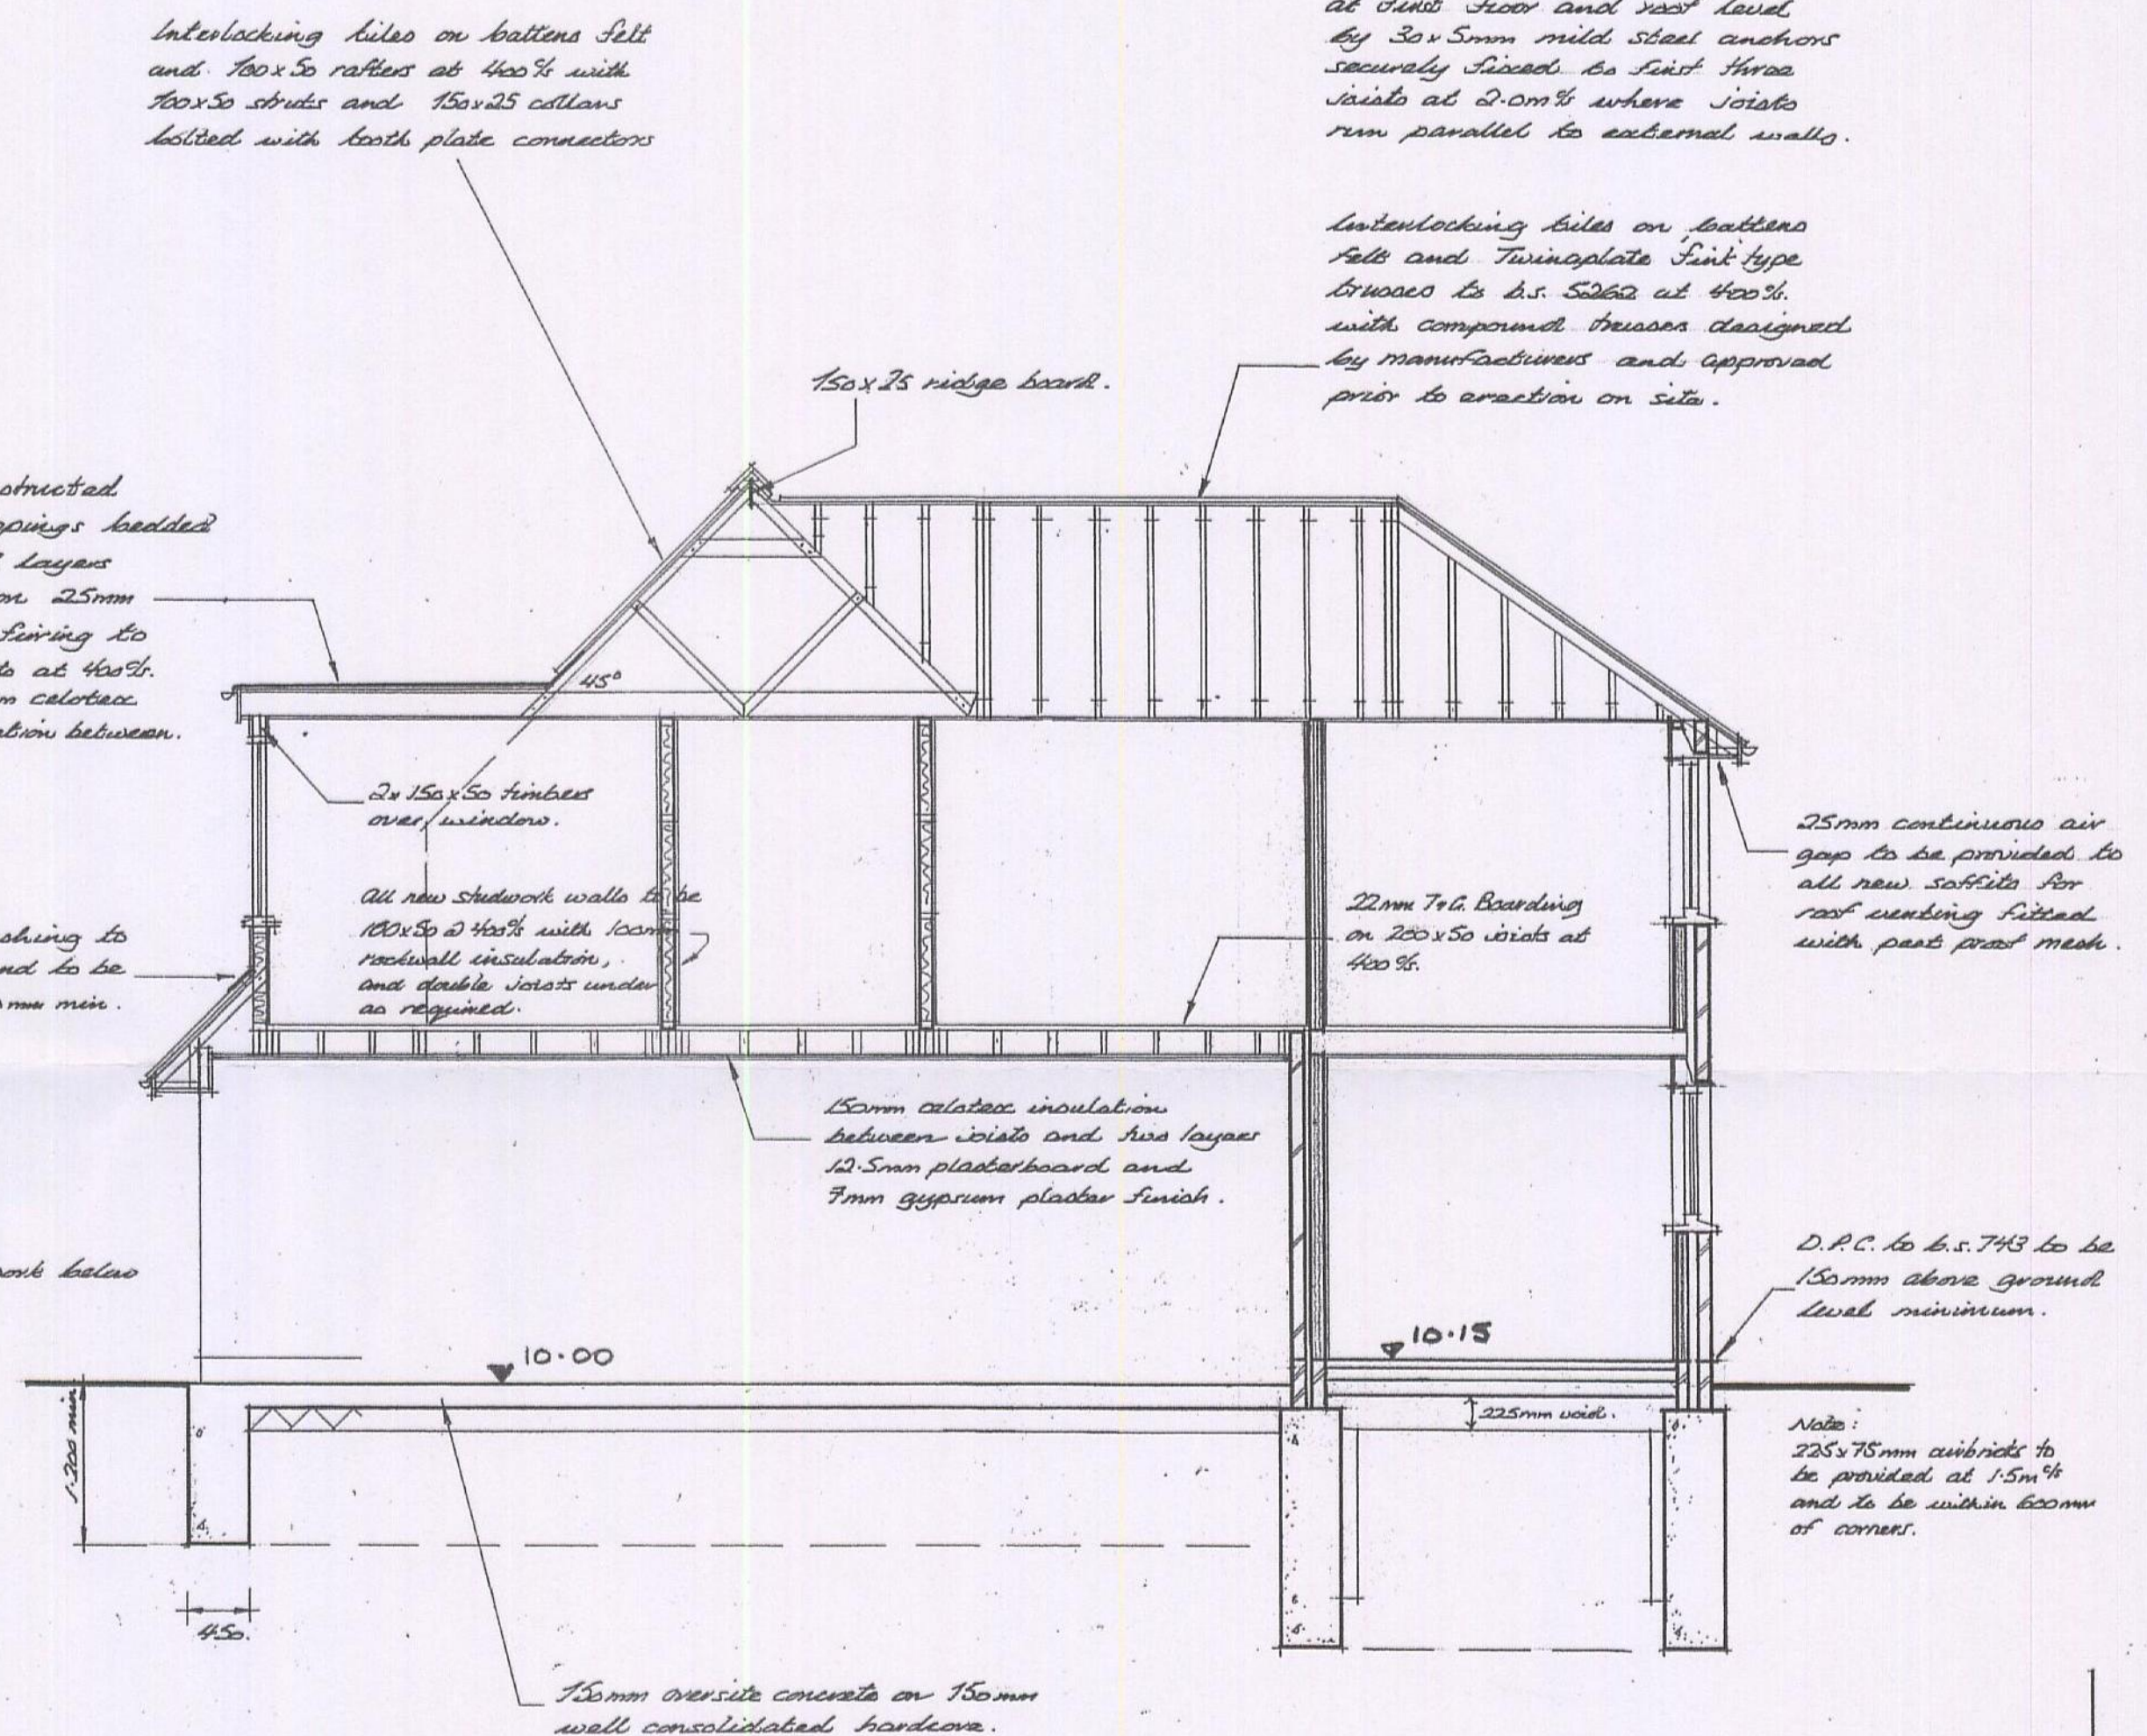

SECTION B-B.

Drainage:

All new soil and surface water drains to be 100mm flexible jointed pipes 'Hoptone' or similar laid in and surrounded in 150mm peashingle minimum.

New 1.0" to be concrete sections 450x600 internal with 150mm concrete backfill on 150mm concrete base.

New soakaway to be 1m below invert of pipe 5.00m away from building and filled with clean broken brick to 300mm above pipe and earth backfilled.

38mm waste pipes to sink, shower and bath 32mm pipes to hand basins and 75mm d.s. traps to all fittings.